


## Standard Detail & Specifications

# Pumping Pit - Type 1

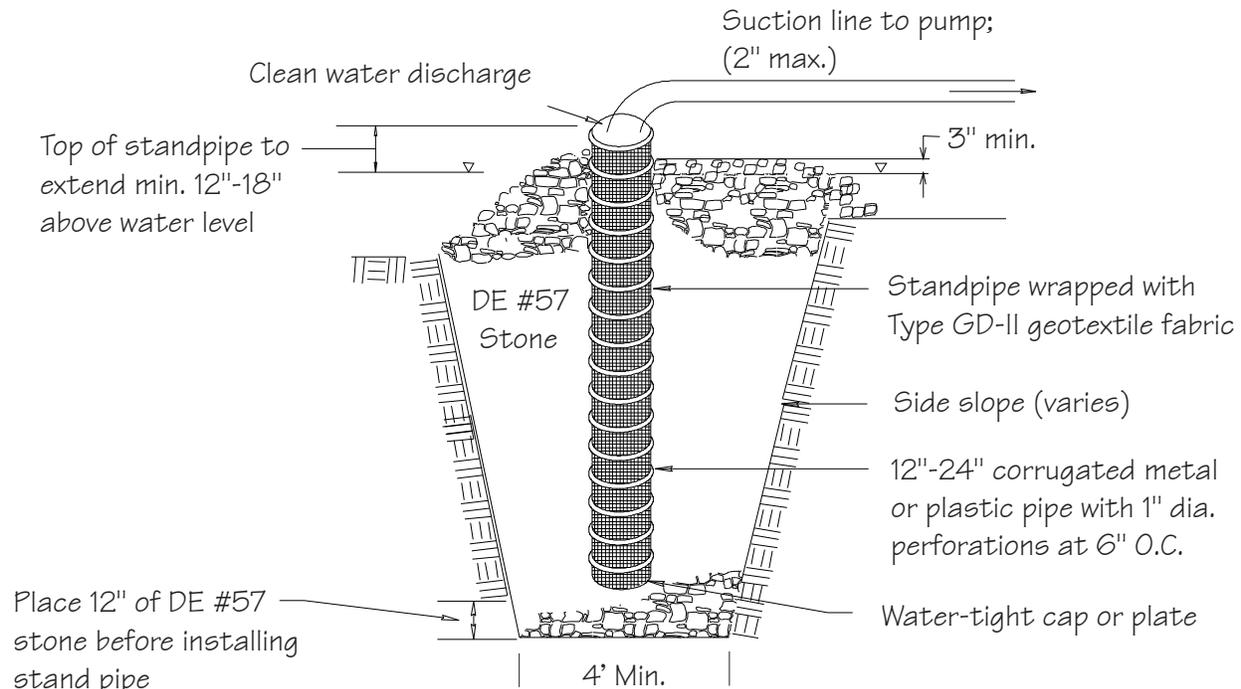

### Section

## Construction Notes:

1. Pit dimensions are variable.
2. The standpipe should be constructed by perforating a 12" to 24" diameter corrugated or PVC pipe. The perforations shall be 1/2" X 6" slits or 1" diameter holes 6" on center.
3. A base of DE #57 aggregate should be placed in the pit to a depth of 12". After installing the standpipe, the pit surrounding the standpipe should then be backfilled with DE #57 aggregate.
4. The standpipe should extend 12" to 18" above the lip of the pit or riser crest elevation (basin dewatering).

**NOTE:** If discharge will be pumped directly to a storm drainage system, the standpipe must be wrapped with Type GD-II geotextile fabric before installation. If desired, 1/2" hardware cloth may be placed around the standpipe, prior to attaching the geotextile fabric. This will increase the rate of water seepage into the pipe.

Source:

Adapted from  
MD Stds. & Specs. for ESC

Symbol:



Detail No.

**DE-ESC-3.2.2.1**

Sheet 1 of 1

Effective July 2023